

Test disconnect terminal block - STME 6 - 3035700

Please be informed that the data shown in this PDF Document is generated from our Online Catalog. Please find the complete data in the user's documentation. Our General Terms of Use for Downloads are valid (<http://download.phoenixcontact.com>)



Test disconnect terminal block, Connection method: Spring-cage connection, Cross section: 0.2 mm² - 10 mm², AWG: 24 - 8, Width: 8.2 mm, Color: gray, Mounting type: NS 35/7,5, NS 35/15

Product Features

- ☒ Feed-through terminal blocks of the same shape are available
- ☒ Clear
- ☒ Easy operation
- ☒ Clear selection thanks to printed switching symbols
- ☒ Compact design
- ☒ Six function shafts
- ☒ Flexible and comprehensive accessories
- ☒ Reliably snapped into the end positions
- ☒ Contact made via screw terminal points

Key commercial data

package_quantity	50
GTIN	4046356281416

Technical data

General

Number of levels	1
Number of connections	2
Color	gray
Insulating material	PA
Inflammability class according to UL 94	V0

General

Maximum load current	30 A
Rated surge voltage	6 kV
Pollution degree	3
Surge voltage category	III
Insulating material group	I
Connection in acc. with standard	IEC 60947-7-1
Nominal current I _N	30 A
Nominal voltage U _N	500 V

Test disconnect terminal block - STME 6 - 3035700

Technical data

General

Open side panel	ja
Shock protection test specification	DIN EN 50274 (VDE 0660-514):2002-11
Back of the hand protection	guaranteed
Finger protection	guaranteed
Surge voltage test setpoint	7.3 kV
Result of surge voltage test	Test passed
Power frequency withstand voltage setpoint	1.89 kV
Result of power-frequency withstand voltage test	Test passed
Checking the mechanical stability of terminal points (5 x conductor connection)	Test passed
Bending test rotation speed	10 rpm
Bending test turns	135
Bending test conductor cross section/weight	0.2 mm ² / 0.2 kg
Bending test conductor cross section/weight	6 mm ² / 1.4 kg
Bending test conductor cross section/weight	10 mm ² / 2 kg
Result of bending test	Test passed
Conductor cross section tensile test	0.2 mm ²
Tractive force setpoint	10 N
Conductor cross section tensile test	6 mm ²
Tractive force setpoint	80 N
Conductor cross section tensile test	10 mm ²
Tractive force setpoint	90 N
Tensile test result	Test passed
Tight fit on carrier	NS 35
Setpoint	5 N
Result of tight fit test	Test passed
Result of voltage drop test	Test passed
Temperature-rise test	Test passed
Conductor cross section short circuit testing	4 mm ²
Short-time current	0.48 kA
Short circuit stability result	Test passed
Ageing test for screwless modular terminal block temperature cycles	192
Result of aging test	Test passed
Proof of thermal characteristics (needle flame) effective duration	30 s
Result of thermal test	Test passed
Test specification, oscillation, broadband noise	DIN EN 50155 (VDE 0115-200):2008-03
Test spectrum	Service life test category 1, class B, body mounted
Test frequency	f ₁ = 5 Hz to f ₂ = 150 Hz
ASD level	0.02 g ² /Hz
Acceleration	0.8 g

Test disconnect terminal block - STME 6 - 3035700

Technical data

General

Test duration per axis	5 h
Test directions	X-, Y- and Z-axis
Oscillation, broadband noise test result	Test passed
Test specification, shock test	DIN EN 50155 (VDE 0115-200):2008-03
Shock form	Half-sine
Acceleration	5 g
Shock duration	30 ms
Number of shocks per direction	3
Test directions	X-, Y- and Z-axis (pos. and neg.)
Shock test result	Test passed
Temperature index, insulating material (DIN EN 60216-1 (VDE 0304-21))	120 °C

Dimensions

Width	8.2 mm
Length	100.8 mm
Height NS 35/7,5	49.6 mm
Height NS 35/15	57.1 mm

Connection data

Conductor cross section solid min.	0.2 mm ²
Conductor cross section solid max.	10 mm ²
Conductor cross section AWG/kcmil min.	24
Conductor cross section AWG/kcmil max	8
Conductor cross section stranded min.	0.2 mm ²
Conductor cross section stranded max.	6 mm ²
Min. AWG conductor cross section, stranded	24
Max. AWG conductor cross section, stranded	10
Conductor cross section stranded, with ferrule without plastic sleeve min.	0.25 mm ²
Conductor cross section stranded, with ferrule without plastic sleeve max.	6 mm ²
Conductor cross section stranded, with ferrule with plastic sleeve min.	0.25 mm ²
Conductor cross section stranded, with ferrule with plastic sleeve max.	6 mm ²
2 conductors with same cross section, stranded, TWIN ferrules with plastic sleeve, min.	0.5 mm ²
2 conductors with same cross section, stranded, TWIN ferrules with plastic sleeve, max.	1.5 mm ²
Connection method	Spring-cage connection
Stripping length	12 mm
Internal cylindrical gage	A4

Test disconnect terminal block - STME 6 - 3035700

classifications

eCl@ss

eCl@ss 4.0	27141126
eCl@ss 4.1	27141126
eCl@ss 5.0	27141126
eCl@ss 5.1	27141126
eCl@ss 6.0	27141126
eCl@ss 7.0	27141126
eCl@ss 8.0	27141126

ETIM

ETIM 2.0	EC000902
ETIM 3.0	EC000902
ETIM 4.0	EC000902
ETIM 5.0	EC000902

UNSPSC

UNSPSC 6.01	30211811
UNSPSC 7.0901	39121410
UNSPSC 11	39121410
UNSPSC 12.01	39121410
UNSPSC 13.2	39121410

approvals

UL Recognized / cUL Recognized / GOST / GOST / cULus Recognized /

Approval details

UL Recognized 				
Usegroups	B	C	D	
Nominal voltage UN	300 V	300 V	600 V	600 V
Nominal current IN	30 A	30 A	5 A	30 A
mm²/AWG/kcmil	24-8	24-8	24-8	24-8

cUL Recognized 				
Usegroups	B	C	D	
Nominal voltage UN	300 V	300 V	600 V	600 V
Nominal current IN	30 A	30 A	5 A	30 A
mm²/AWG/kcmil	24-8	24-8	24-8	24-8

Test disconnect terminal block - STME 6 - 3035700

approvals



cULus Recognized 

accessories

Screwdriver tools

SZF 2-0,8X4,0 - 1204520



SZF 1-0,6X3,5 - 1204517



End cover

D-DTME 6 - 3034426



Test disconnect terminal block - STME 6 - 3035700

accessories

DP PS-6 - 3036738



Bridge

C-ME 6/2 - 3034442



C-ME 6/3 - 3034390



FBS 2-8 - 3030284



FBS 3-8 - 3030297



Test disconnect terminal block - STME 6 - 3035700

accessories

FBS 4-8 - 3030307



FBS 5-8 - 3030310



FBS 10-8 - 3030323



FBS 6-8 - 3032470



FBS 1/3-8 - 3032363



FBS 1/4-8 - 3032376



Test disconnect terminal block - STME 6 - 3035700

accessories

FBS 1/3/5-8 - 3032389



FBS 1/4/7/10-8 - 3032402



SB-ME 2-8 - 3034468



SB-ME 3-8 - 3032800



SB-ME 4-8 - 3034484



Test disconnect terminal block - STME 6 - 3035700

accessories

FBS 1/5-8 - 3032381

FBSRH 2-8 - 3033802



FBSRH 3-8 - 3033803



FBSRH 4-8 - 3033804



FBSR 2-8 - 3033808



FBSR 3-8 - 3001597



Test disconnect terminal block - STME 6 - 3035700

accessories

FBSR 5-8 - 3033809



FBSR 10-8 - 3001599



FBSR 16-8 - 3033816



FBSR 1/6/11/16-8 - 3033820



FBSR 1/7/13/16-8 - 3033821



Test disconnect terminal block - STME 6 - 3035700

accessories

FBSR 1/6/11/14-8 - 3033822



Switching lock

S-ME 6 - 3034439



Flange

CARRIER 35-8 - 3034387



Cover profile

AP-ME METER - 3034361



APH-ME - 3034374



Test disconnect terminal block - STME 6 - 3035700

accessories

APT-ME - 3034358



AH-ME - 3240265



Documentation

ST-IL - 3039900



Mounting rail

NS 35/ 7,5 PERF 2000MM - 0801733



NS 35/ 7,5 UNPERF 2000MM - 0801681



Test disconnect terminal block - STME 6 - 3035700

accessories

NS 35/ 7,5 WH PERF 2000MM - 1204119



NS 35/ 7,5 WH UNPERF 2000MM - 1204122



NS 35/ 7,5 AL UNPERF 2000MM - 0801704



NS 35/ 7,5 ZN PERF 2000MM - 1206421



NS 35/ 7,5 ZN UNPERF 2000MM - 1206434



NS 35/ 7,5 CU UNPERF 2000MM - 0801762



Test disconnect terminal block - STME 6 - 3035700

accessories

NS 35/ 7,5 CAP - 1206560



NS 35/15 PERF 2000MM - 1201730



NS 35/15 UNPERF 2000MM - 1201714



NS 35/15 WH PERF 2000MM - 0806602



NS 35/15 WH UNPERF 2000MM - 1204135



Test disconnect terminal block - STME 6 - 3035700

accessories

NS 35/15 AL UNPERF 2000MM - 1201756



NS 35/15 ZN PERF 2000MM - 1206599



NS 35/15 ZN UNPERF 2000MM - 1206586



NS 35/15 CU UNPERF 2000MM - 1201895



NS 35/15 CAP - 1206573



NS 35/15-2,3 UNPERF 2000MM - 1201798



Test disconnect terminal block - STME 6 - 3035700

accessories

Terminal marking

ZB 8:UNBEDRUCKT - 1052002



UC-TM 8 - 0818072



UCT-TM 8 - 0828740



ZBF 8:UNBEDRUCKT - 0808781



UC-TMF 8 - 0818137



Test disconnect terminal block - STME 6 - 3035700

accessories

UCT-TMF 8 - 0828748



Labeled terminal marker

ZB 8 CUS - 0825011



UC-TM 8 CUS - 0824597



UCT-TM 8 CUS - 0829616



ZBF 8 CUS - 0825030



Test disconnect terminal block - STME 6 - 3035700

accessories

UC-TMF 8 CUS - 0824654



UCT-TMF 8 CUS - 0829672



Test plug terminal block

PAI-4-FIX BU - 3032729



PAI-4-FIX OG - 3034455



PAI-4-FIX YE - 3032745



Test disconnect terminal block - STME 6 - 3035700

accessories

PAI-4-FIX RD - 3032732



PAI-4-FIX GN - 3032758



PAI-4-FIX BK - 3032774



PAI-4-FIX GY - 3032790



PAI-4-FIX VT - 3032761



PAI-4-FIX BN - 3032787



Test disconnect terminal block - STME 6 - 3035700

accessories

PS-6 - 3030996



PS-6/2,3MM RD - 3038736



End block

CLIPFIX 35 - 3022218



CLIPFIX 35-5 - 3022276




E/NS 35 N - 0800886



Drawings


Test disconnect terminal block - STME 6 - 3035700

Connection diagram

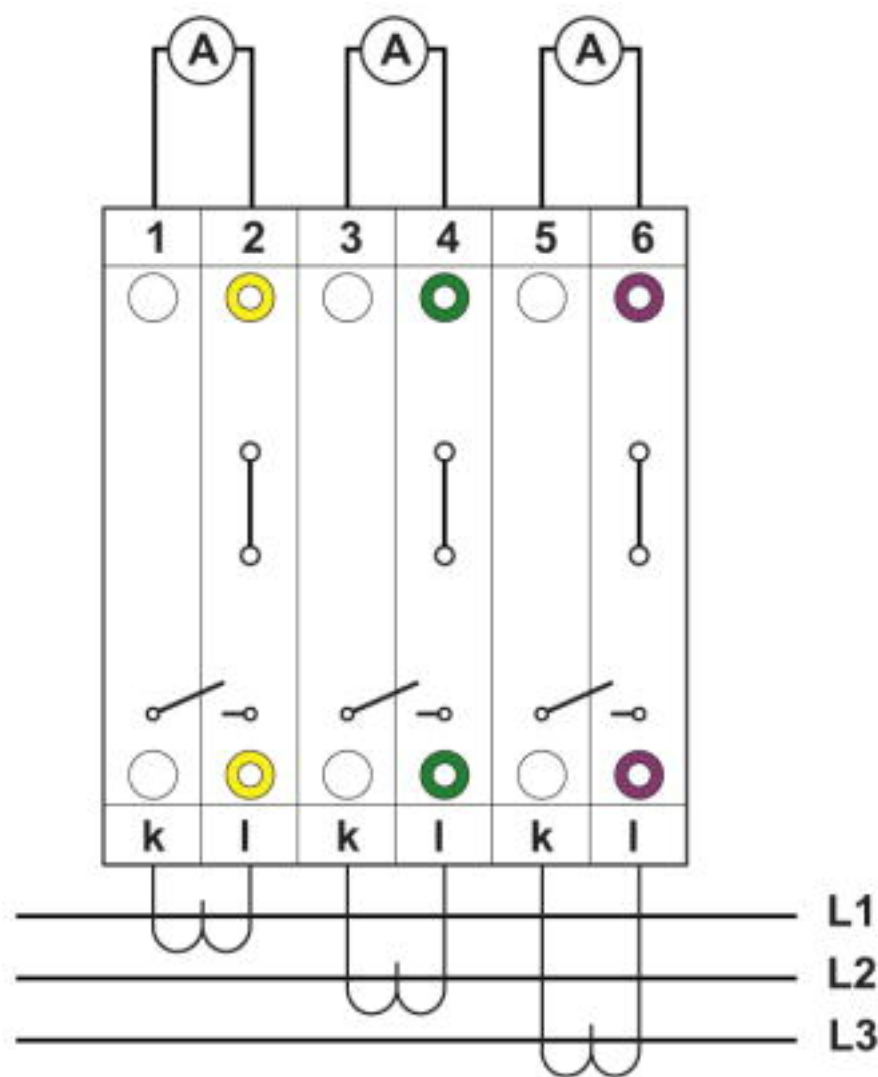


Test disconnect terminal block - STME 6 - 3035700

Connection diagram

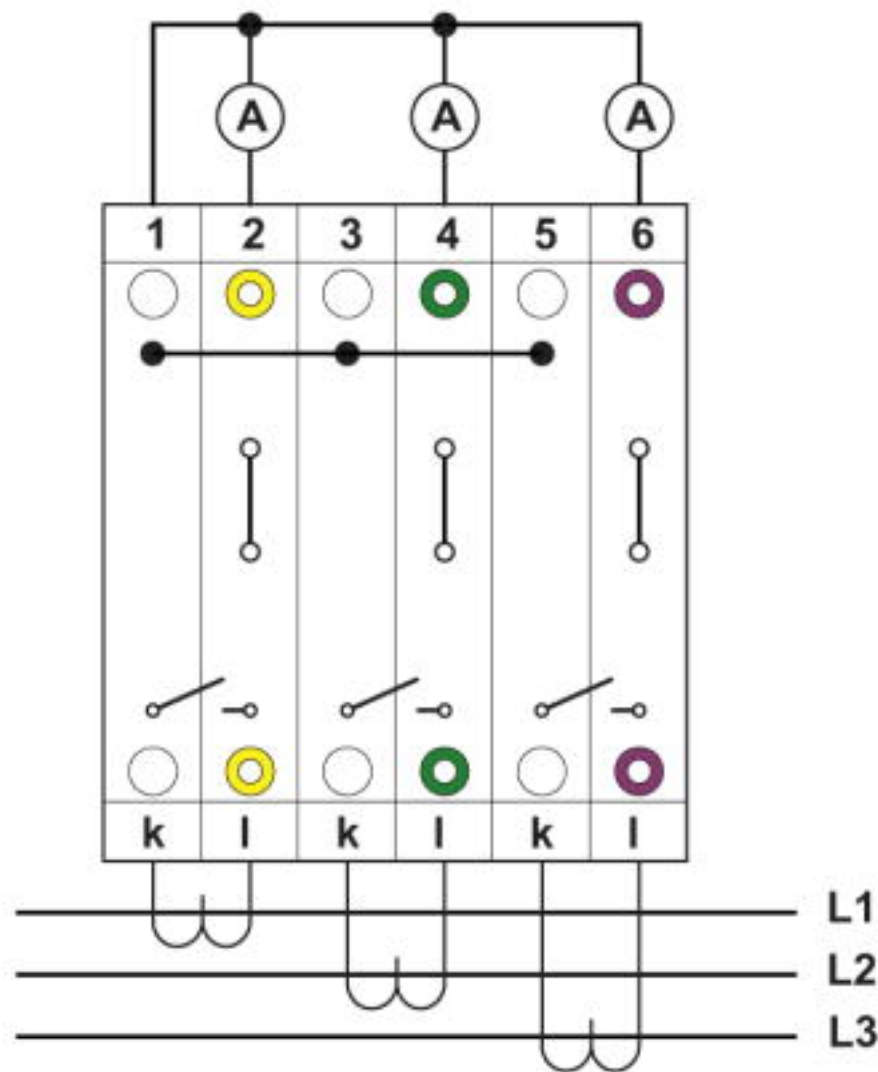

Test disconnect terminal block - STME 6 - 3035700


Connection diagram

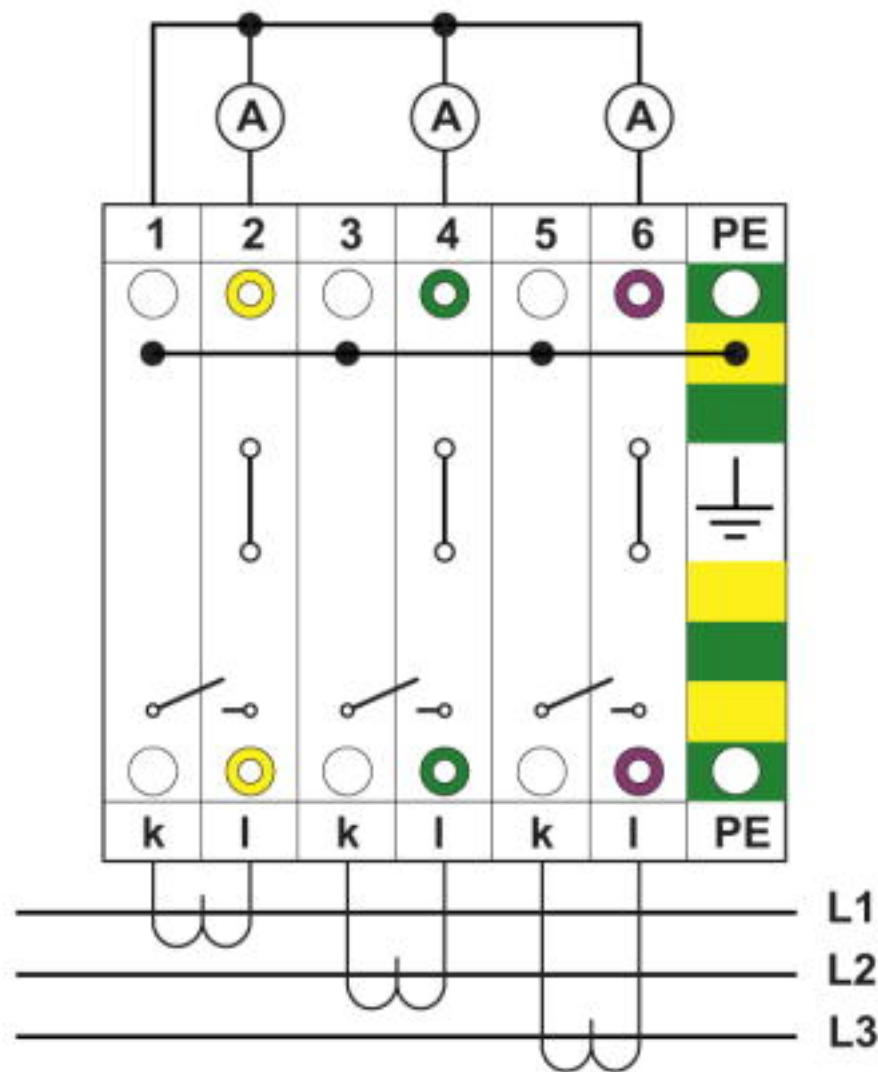

with PE terminals having the same contours


Test disconnect terminal block - STME 6 - 3035700

Connection diagram

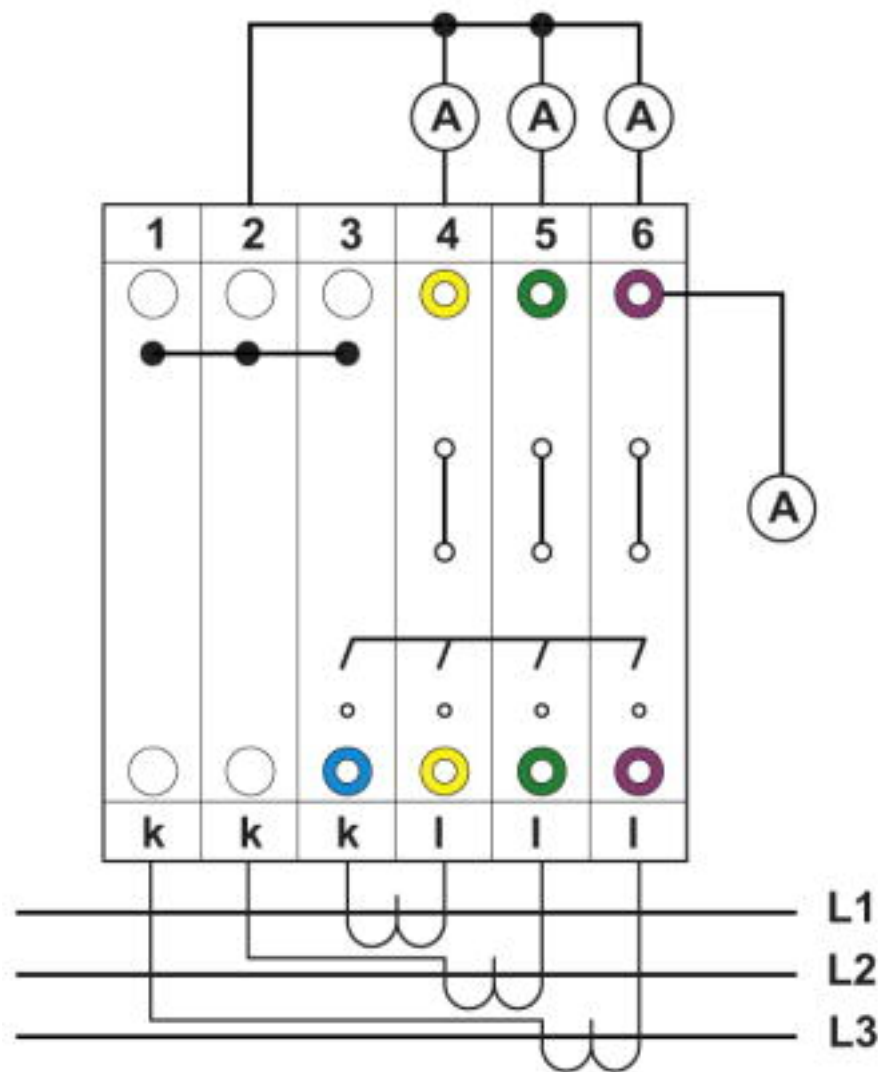


chained

Circuit diagram

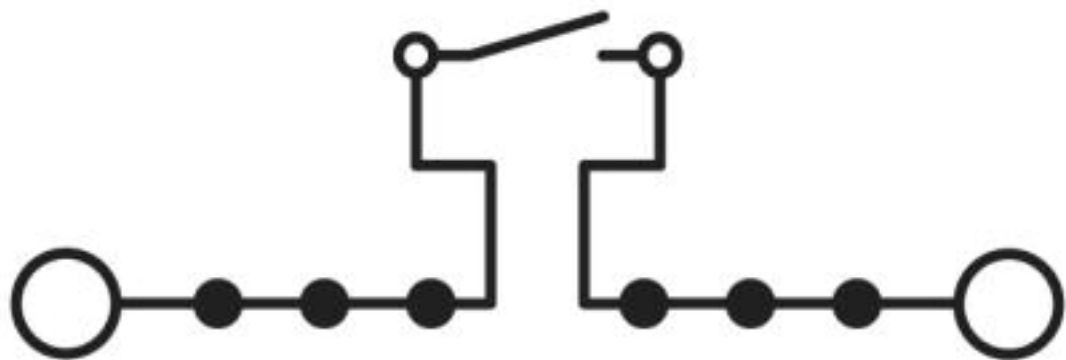

Test disconnect terminal block - STME 6 - 3035700


Schematic diagram

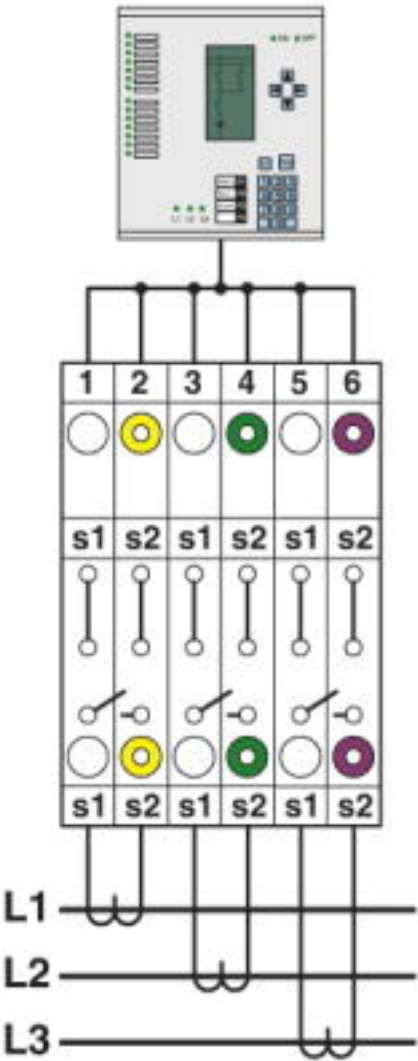

Simple three-phase current transformer set

Test disconnect terminal block - STME 6 - 3035700


Schematic diagram

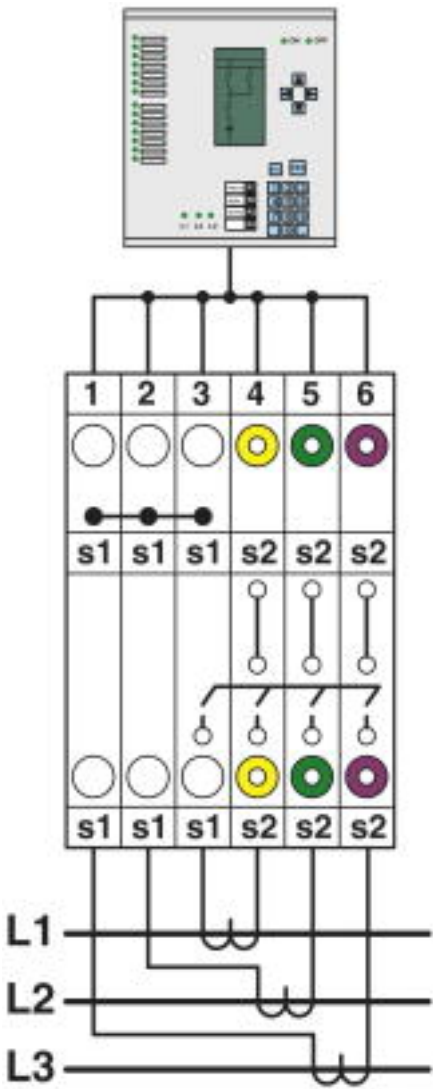

Interlinked three-phase current transformer set

Test disconnect terminal block - STME 6 - 3035700

Schematic diagram

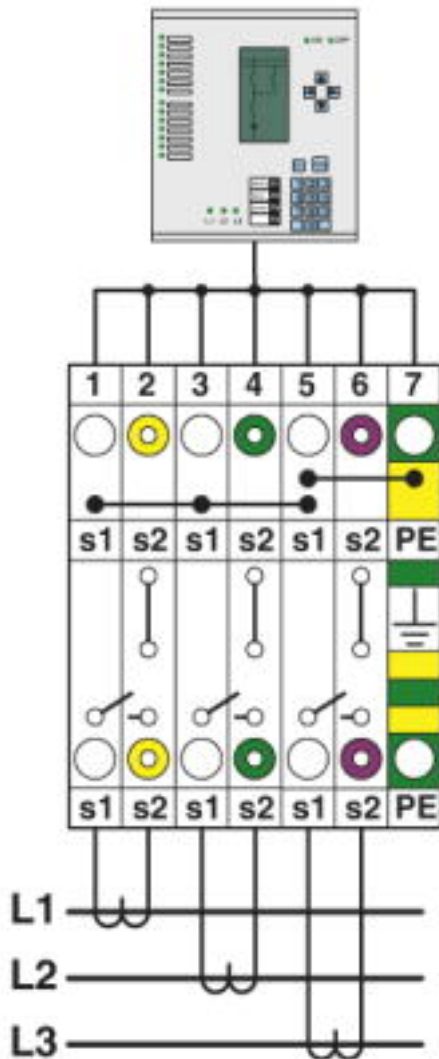

Interlinked three-phase current transformer set with grounded star point

© Phoenix Contact 2013 - all rights reserved
<http://www.phoenixcontact.com>