

Test disconnect terminal block - RT 5-T - 3049039

Please be informed that the data shown in this PDF Document is generated from our Online Catalog. Please find the complete data in the user's documentation. Our General Terms of Use for Downloads are valid (<http://download.phoenixcontact.com>)



Disconnect terminal block with bolt connection method, cross section: 0.1 - 6 mm², AWG: 26 - 10, width: 16.3 mm, color: gray

Product Features

- ✓ The special clamping nuts can be actuated with a normal screwdriver
- ✓ Tested for railway applications
- ✓ Quick and easy connection thanks to hinged cover flaps which hold the clamping nuts captive. When the flaps are open, the connection bolt is freely accessible and the cable lugs can be hooked in; after closing and engaging the flaps
- ✓ Easy bridging and potential distribution using the patented plug-in bridges from the CLIPLINE complete system
- ✓ The screws are secured against loosening by captive spring-loaded spacers
- ✓ Large-surface labeling options in the terminal center and above the terminal points
- ✓ The use of the switching lock effectively prevents unintentional switching
- ✓ The hinged cover cover the live metal parts including the insulated cable lugs in the clamping area so that they are touch proof
- ✓ Testing with the standardized test adapters and test plugs of the CLIPLINE complete system

Key commercial data

package_quantity	25
GTIN	4046356139991

Technical data

General

Note	Note: the BE-RT... path extension is to be used for non-insulated cable lugs (see accessories).
Number of levels	1
Number of connections	2
Color	gray
Insulating material	PA
Inflammability class according to UL 94	V0
Area of application	Railway industry
Area of application	Mechanical engineering
Area of application	Plant engineering

General

Maximum load current	41 A (with 6 mm ² conductor cross section)
Rated surge voltage	6 kV
Pollution degree	3

Test disconnect terminal block - RT 5-T - 3049039

Technical data

General

Surge voltage category	III
Insulating material group	I
Connection in acc. with standard	IEC 60947-7-1
Nominal current I_N	41 A
Nominal voltage U_N	1000 V (Rated voltage for open disconnect point 500 V)
Open side panel	ja
Shock protection test specification	DIN EN 50274 (VDE 0660-514):2002-11
Back of the hand protection	guaranteed
Finger protection	guaranteed
Surge voltage test setpoint	7.3 kV
Result of surge voltage test	Test passed
Power frequency withstand voltage setpoint	1.89 kV
Result of power-frequency withstand voltage test	Test passed
Checking the mechanical stability of terminal points (5 x conductor connection)	Test passed
Tight fit on carrier	NS 35
Setpoint	5 N
Result of tight fit test	Test passed
Result of voltage drop test	Test passed
Temperature-rise test	Test passed
Conductor cross section short circuit testing	6 mm ²
Short-time current	0.72 kA
Short circuit stability result	Test passed
Proof of thermal characteristics (needle flame) effective duration	30 s
Result of thermal test	Test passed
Test specification, oscillation, broadband noise	DIN EN 50155 (VDE 0115-200):2008-03
Test spectrum	Service life test category 1, class B, body mounted
Test frequency	$f_1 = 5 \text{ Hz}$ to $f_2 = 150 \text{ Hz}$
ASD level	0.02 g ² /Hz
Acceleration	0.8 g
Test duration per axis	5 h
Test directions	X-, Y- and Z-axis
Oscillation, broadband noise test result	Test passed
Test specification, shock test	DIN EN 50155 (VDE 0115-200):2008-03
Shock form	Half-sine
Acceleration	5 g
Shock duration	30 ms
Number of shocks per direction	3
Test directions	X-, Y- and Z-axis (pos. and neg.)
Shock test result	Test passed

Test disconnect terminal block - RT 5-T - 3049039

Technical data

General

Temperature index, insulating material (DIN EN 60216-1 (VDE 0304-21))	120 °C
---	--------

Dimensions

Width	16.3 mm
Length	91.4 mm
Height NS 35/7,5	51 mm
Height NS 35/15	58.5 mm

Connection data

Note	Connection bolts
Conductor cross section solid min.	0.1 mm ²
Conductor cross section solid max.	6 mm ²
Conductor cross section AWG/kcmil min.	26
Conductor cross section AWG/kcmil max	10
Conductor cross section stranded min.	0.1 mm ²
Conductor cross section stranded max.	6 mm ²
Min. AWG conductor cross section, stranded	26
Max. AWG conductor cross section, stranded	10
Min. cross section for cable lug connection	0.5 mm ²
Max. cross section for cable lug connection	6 mm ²
Connection method	Bolt connection
Screw thread	M5
Tightening torque, min	2.5 Nm
Tightening torque max	3 Nm

classifications

eCl@ss

eCl@ss 4.0	27141126
eCl@ss 4.1	27141126
eCl@ss 5.0	27141126
eCl@ss 5.1	27141126
eCl@ss 6.0	27141126
eCl@ss 7.0	27141126
eCl@ss 8.0	27141126

ETIM

ETIM 2.0	EC000902
ETIM 3.0	EC000902
ETIM 4.0	EC000902
ETIM 5.0	EC000902

UNSPSC

Test disconnect terminal block - RT 5-T - 3049039

classifications

UNSPSC

UNSPSC 6.01	30211811
UNSPSC 7.0901	39121410
UNSPSC 11	39121410
UNSPSC 12.01	39121410
UNSPSC 13.2	39121410

approvals

UL Recognized / cUL Recognized / GOST / UL Recognized / GOST / cULus Recognized /

Approval details

UL Recognized 		
Usegroups	B	C
Nominal voltage UN	600 V	600 V
Nominal current IN	30 A	30 A
mm²/AWG/kcmil		

cUL Recognized 		
Usegroups	B	C
Nominal voltage UN	600 V	600 V
Nominal current IN	30 A	30 A
mm²/AWG/kcmil		

GOST 

UL Recognized 			
Usegroups	B	C	D
Nominal voltage UN	600 V	600 V	300 V
Nominal current IN	30 A	30 A	10 A
mm²/AWG/kcmil			

Test disconnect terminal block - RT 5-T - 3049039

approvals



cULus Recognized us

accessories

End cover

D-RT 3/5 - 3049097



BE-RT 3/5 - 3049819



DP PS-8 - 3036741



Screwdriver tools

SZS 0,6X3,5 - 1205053



Test disconnect terminal block - RT 5-T - 3049039

accessories

Partition plate

TPNS-UK - 0706647



Bridge

FBS 2-8 - 3030284



FBS 3-8 - 3030297



FBS 4-8 - 3030307



FBS 5-8 - 3030310



Test disconnect terminal block - RT 5-T - 3049039

accessories

FBSRH 2-8 - 3033802



FBSRH 3-8 - 3033803



FBSRH 4-8 - 3033804



Mounting rail

NS 35/ 7,5 PERF 2000MM - 0801733



NS 35/ 7,5 UNPERF 2000MM - 0801681



Test disconnect terminal block - RT 5-T - 3049039

accessories

NS 35/ 7,5 WH PERF 2000MM - 1204119



NS 35/ 7,5 WH UNPERF 2000MM - 1204122



NS 35/ 7,5 AL UNPERF 2000MM - 0801704



NS 35/ 7,5 ZN PERF 2000MM - 1206421



NS 35/ 7,5 ZN UNPERF 2000MM - 1206434



NS 35/ 7,5 CU UNPERF 2000MM - 0801762



Test disconnect terminal block - RT 5-T - 3049039

accessories

NS 35/ 7,5 CAP - 1206560



NS 35/15 PERF 2000MM - 1201730



NS 35/15 UNPERF 2000MM - 1201714



NS 35/15 WH PERF 2000MM - 0806602



NS 35/15 WH UNPERF 2000MM - 1204135



Test disconnect terminal block - RT 5-T - 3049039

accessories

NS 35/15 AL UNPERF 2000MM - 1201756



NS 35/15 ZN PERF 2000MM - 1206599



NS 35/15 ZN UNPERF 2000MM - 1206586



NS 35/15 CU UNPERF 2000MM - 1201895



NS 35/15 CAP - 1206573



NS 35/15-2,3 UNPERF 2000MM - 1201798



Test disconnect terminal block - RT 5-T - 3049039

accessories

Terminal marking

ZB 12:UNPRINTED - 0812120



UC-TM 12 - 0819194



UCT-TM 12 - 0829144



ZB 16,3:UNPRINTED - 0820222



Labeled terminal marker

ZB 12 CUS - 0824942



Test disconnect terminal block - RT 5-T - 3049039

accessories

UC-TM 12 CUS - 0824613



UCT-TM 12 CUS - 0829630



ZB 16,3 CUS - 0824946



Test plug terminal block

MPS-MT - 0201744



PAI-4-N GY - 3032871



Test disconnect terminal block - RT 5-T - 3049039

accessories

PS-8 - 3031005



PS-8/2,3MM RD - 3048564



Insulating sleeve

MPS-IH WH - 0201663



MPS-IH RD - 0201676



MPS-IH BU - 0201689



Test disconnect terminal block - RT 5-T - 3049039

accessories

MPS-IH YE - 0201692



MPS-IH GN - 0201702



MPS-IH GY - 0201728



MPS-IH BK - 0201731



End block

CLIPFIX 35 - 3022218



Test disconnect terminal block - RT 5-T - 3049039

accessories

CLIPFIX 35-5 - 3022276



E/NS 35 N - 0800886



E/UK - 1201442




E/UK 1 - 1201413



Drawings

Test disconnect terminal block - RT 5-T - 3049039


Connection diagram

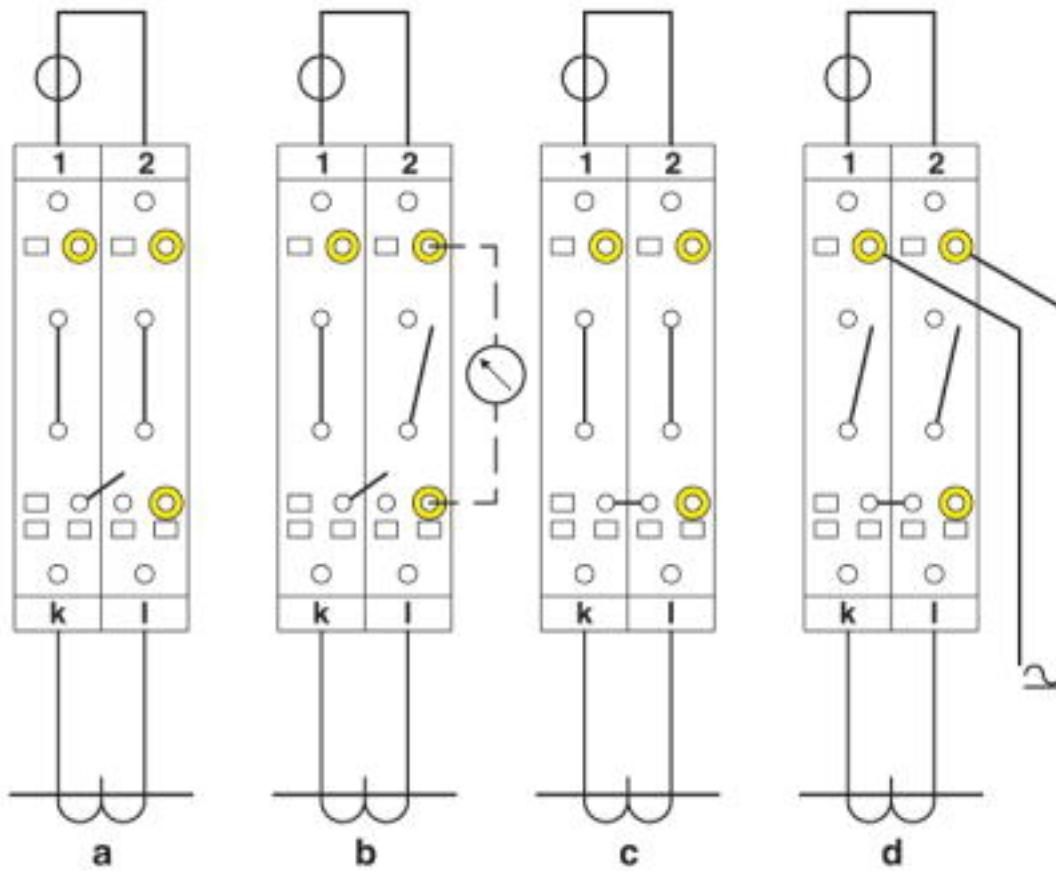

Simple current transformer test circuit
 a = normal operation
 b = measured value testing
 c = transformer testing
 d = relay testing

Test disconnect terminal block - RT 5-T - 3049039


Connection diagram

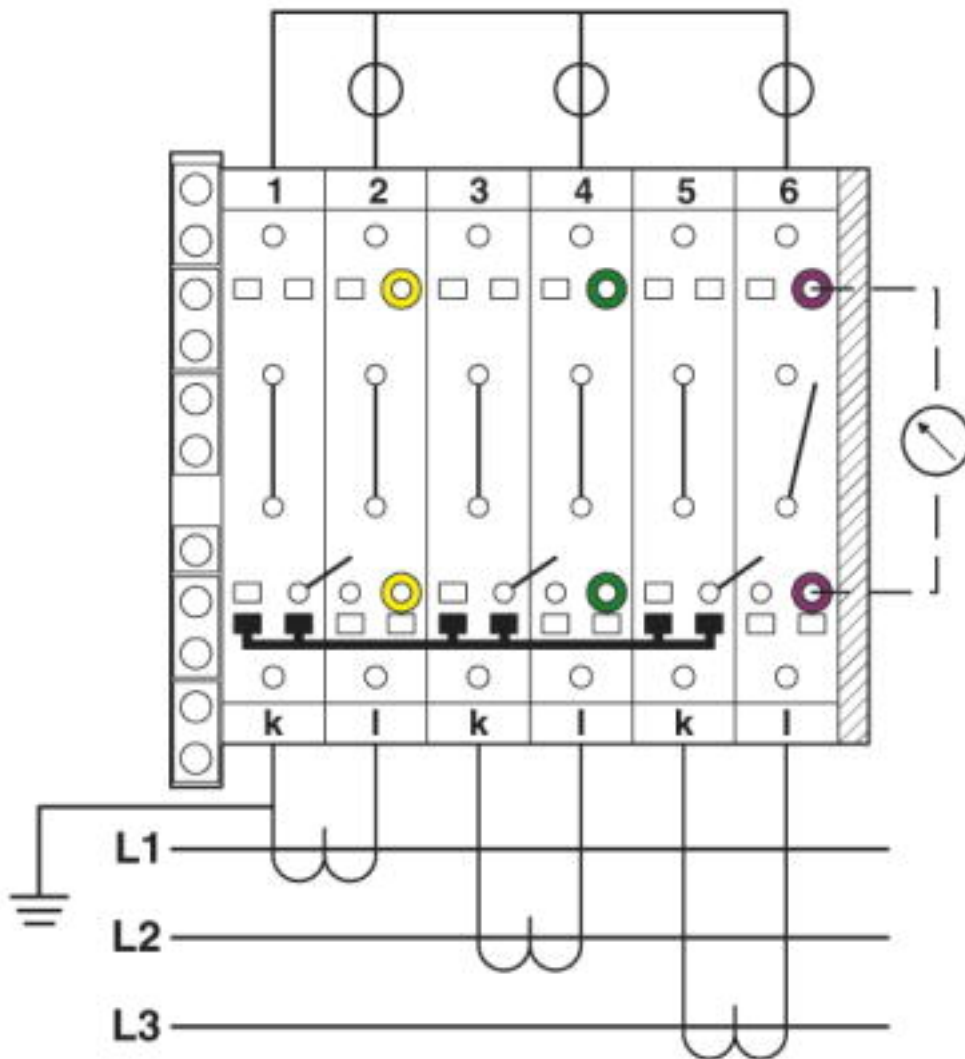

Three-phase transducer test set

Test disconnect terminal block - RT 5-T - 3049039

Connection diagram

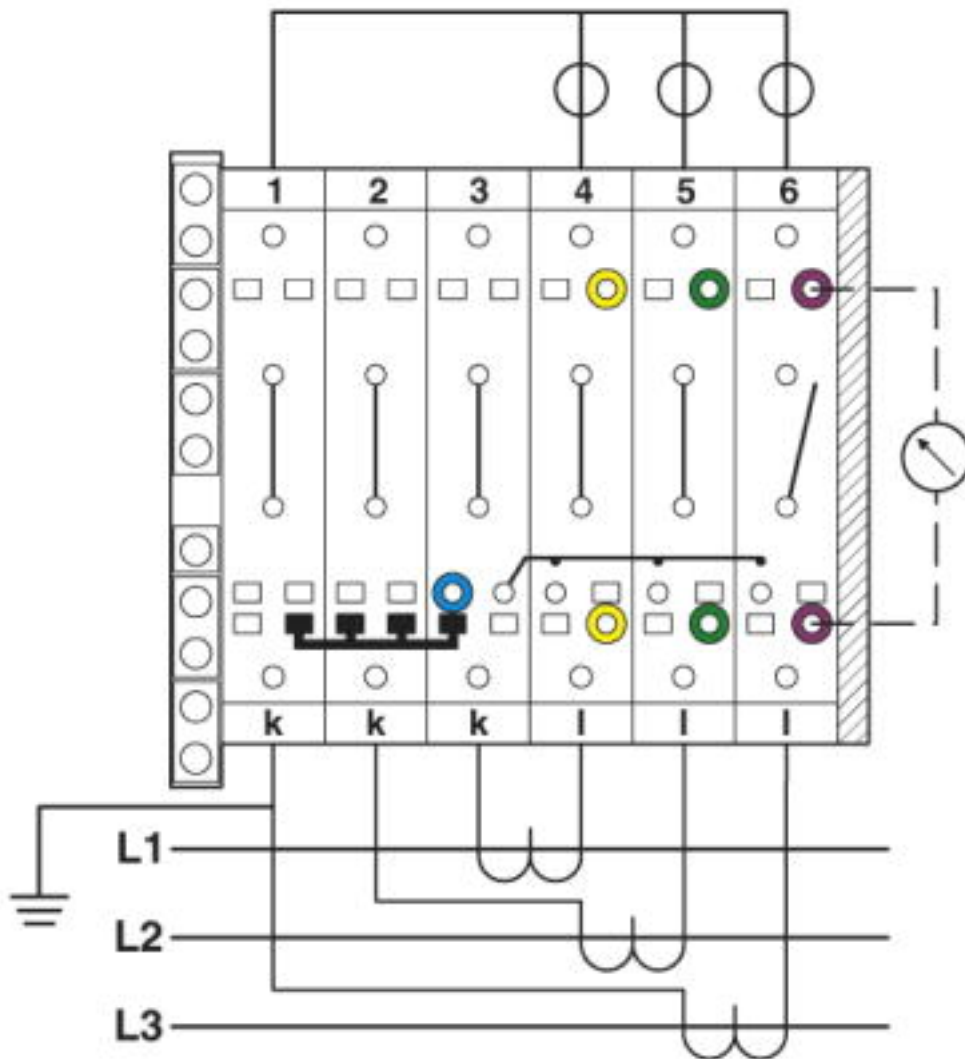

Three-phase linked transducer test set

Circuit diagram

