Anybus® X-gateway™ CANopen® - PROFINET® INSTALLATION SHEET




HMS Industrial Networks AB Box 4126 300 04 Halmstad, Sweden info@hms.se




SP1197, Rev 2.20. AB7307.

www.anybus.com

Module Front

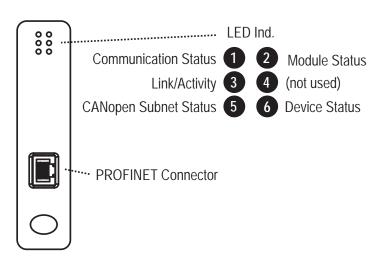


Network Access Port



Pin no	Description	
1	TX+	
2	TX-	
3	RX+	
6	RX-	
4, 5, 7, 8	Termination	


Side View

Setting	Baud Rate (kbit/s)
0	20
1	50
2	125
3	250
4	500
5	800
6	1000
7	Auto
8, 9	Not available



Allowed node address range is 1 - 127. Addresses 1 - 99 are available using the address rotary switches. To set e.g. node address 42, set the left address switch to 4 and the right address switch to 2. Cover the switches with the enclosed switch covers to ensure EMC compliance.

Bottom View



CANopen Connector

Pin no.	Description	
2	CAN_L	
5	Shield	
7	CAN_H	
3, 6	CAN_GND	
1, 4, 8, 9	(not connected)	

LED Indicators

LED no	Indication	Meaning
1 (Communication Status)	Off Green Flashing green	Not online Online, connection with IO established, IO control- ler in run state Online, connection with IO established, IO control- ler in stop state
2 (Module status)	Off Green Single flash, green Double flash, green Single flash, red Triple flash, red Quadruple flash, red	Module initialized Module initialized, no errors Diagnostics available Used by engineering tool to identify the module Configuration error No station name or no IP address assigned Failed to initialize PROFINET IO object or no MAC address
3 (Link/Activitiy)	Off Green Flashing green	No link Link established Packet is recieved or transmitted
4 (not used)	-	
5 (CANopen Subnet Status) ¹	Off Flickering green/red Blinking green Single flash, green Green Blinking red Single flash, red Double flash, red Triple flash, red Quadruple flash, red Red	Power off The LSS services are in progress Pre-operational state Stopped state Operational state Configuration error Warning limit reached Error control event Sync error Data communication timeout Bus off
6 (Device Status)	Off Single flash, green Green Single flash, red Double flash, red Triple flash, red Quadruple flash, red Red	Power off Bootup Running Initialization error Timeout Hardware failure General error Fatal error

^{1.} This LED shows the status of the CANopen subnet that is controlled by the

Accessories Checklist

The following items are required for installation:

CANopen:

- ACM CANopen configuration tool (available at www.anybus.com)
- CANopen adapter for configuration tool (not included)
- CANopen cable (not included)
- EDS file, available at www.anybus.com

PROFINET IO Interface:

- Suitable LAN cable (not included)
- PROFINET configuration tool (not included)
- GSD file, available at www.anybus.com

Installation and Startup Summary

- Select baud rate and an unused node address for the interface. (Cover the switches with the enclosed switch covers.)
- Connect the gateway to the CANopen network.
- Install the EDS file in the CANopen configuration tool.
- Power up and (if required) configure the module.
- Restart the module after the CANopen interface has been configured.
- Connect the gateway to the PROFINET network.
- $\bullet \qquad \hbox{Install the GSD file in the PROFINET configuration tool,} \\$
- Power up and (if required) configure the module.

Please note that the module will start up as a CANopen slave. The module can be reconfigured as a CANopen master during configuration.

Technical Details

- Power supply:
 24 V DC (-10% to +10%).
- Power consumption:

 Maximum power consumption is 250 mA @ 24 V DC.

 Typical power consumption: 100 mA @ 24 V DC.
- Protective Earth (PE):
 Internal connection to PE via DIN-rail.

 Note: Make sure the DIN-rail is properly connected to PE.

CANopen Support

Technical support regarding the CANopen fieldbus system should be addressed to CAN in Automation (CiA), at: www.can-cia.org

PROFINET IO Support


Technical questions regarding the PROFINET IO fieldbus system should be addressed to your local PROFINET user group, at: www.profibus.org

For maintenance and support, contact the HMS support department. Contact information is available at the support pages at: www.anybus.com.

Further information and documents about this product can be found at the product pages at: www.anybus.com.

Anybus® X-gateway™ CANopen® INSTALLATION SHEET

DIN Rail Mounting



To mount the gateway on a DIN rail, first press it downwards (1) to compress the spring in the rail mechanism, then push it against the rail as to make it snap on (2).

To dismount the gateway, push it downwards (1) and pull it out from the rail (2).

Additional Installation and Operating Instructions

This equipment requires a regulated 24 V (21.6 V to 26.4 V) DC power source

Field wiring terminal markings (wire type (Cu only, 14-30 AWG)) Use 60/75 or 75 °C copper (Cu) wire only. Terminal tightening torque: 5–7 lb-in (0.5–0.8 Nm)

Use in Overvoltage Category I Pollution Degree 2 Environment conforming to EN 60664-1.

Operating temperature/Surrounding temperature: -25 to +55 $^{\circ}$ C @ 250 mA @ 24 V DC

Maximum surface temperature: 135 °C

Pressure: 850-1050 millibar (85-105 kPa)

This product is designed to safely operate in class I, division 2 Hazardous location according to ANSI/ISA 12.12.01-2013 and category 3, zone 2 according to EN 60079-0:2012 and EN 60079-15:2010.

SUITABLE FOR USE IN CLASS I, DIVISION 2, GROUPS A, B, C AND D HAZARDOUS LOCATIONS, OR NONHAZARDOUS LOCATIONS ONLY.

To comply with ATEX directives, the equipment must be installed within an IP54 enclosure and must be installed with a transient suppressor on the supply that does not exceed 140 % (33.6 V DC) of the nominal rated supply voltage.

Warnings

- WARNING EXPLOSION HAZARD SUBSTITION OF ANY COMPONENTS MAY IMPAIR SUITABILITY FOR CLASS I, DIVISION 2.
- WARNING EXPLOSION HAZARD WHEN IN HAZARD-OUS LOCATIONS, TURN OFF POWER BEFORE REPLAC-ING OR WIRING MODULES.
- WARNING EXPLOSION HAZARD DO NOT DISCONNECT EQUIPMENT WHILE THE CURCUIT IS LIVE OR UNLESS THE AREA IS KNOWN TO BE FREE OF IGNITABLE CON-CENTRATIONS
- WARNING EXPLOSION HAZARD THE USB CONNECTOR IS NOT FOR USE IN HAZARDOUS LOCATIONS AND
 FOR TEMPORARY CONNECTION ONLY. DO NOT USE,
 CONNECT OR DISCONNECT UNLESS THE AREA IS
 KNOWN TO BE NONHAZARDOUS. CONNECTION OR DISCONNECTION IN AN EXPLOSIVE ATMOSPHERE COULD
 RESULT IN AN EXPLOSION.
- WARNING INSTALL IN AN ENCLOSURE CONSIDERED REPRESENTATIVE OF THE INTENDED USE.

UL Certification



IND. CONT. EQ. FOR HAZ. LOC. CL I, DIV 2 GP A,B,C,D TEMP CODE T4 E203225

LISTED 67AM

ATEX Certification

EX nA ic IIC T4 Gc



II 3 G

DEMKO 12 ATEX 1062548X

Attention!

- ATTENTION RISQUE D'EXPLOSION LE REMPLACEMENT DE TOUT COMPOSANTS INVALIDE LA CERTIFICATION CLASS I, DIVISION 2.
- ATTENTION RISQUE D'EXPLOSION EN ZONE EXPLOSIVE, VEUILLEZ COUPER L'ALIMENTATION ÉLECTRIQUE AVANT LE REMPLACEMENT OU LE RACCORDEMENT DES MODULES.
- ATTENTION RISQUE D'EXPLOSION NE PAS DÉCONNECTER L'ÉQUIPEMENT TANT QUE L'ALIMENTATION EST TOUJOURS PRÉSENTE OU QUE LE PRODUIT EST TOUJOURS EN ZONE EXPLOSIVE ACTIVE.
- ATTENTION RISQUE D'EXPLOSION LE CONNECTEUR USB N'EST PAS FAIT POUR UN USAGE EN MILIEU EXPLOSIF. NE PAS, BRANCHER ET DEBRANCHER SANS SAVOIR SI LA ZONE N'EST PAS IDENTIFIEE NON EXPLOSIVE. BRANCHER OU DEBRANCHER EN ZONE EXPLOSIVE PEUT ENTRAINER UNE EXPLOSION.
- AVERTISSEMENT INSTALLER DANS UNE ARMOIRE VERROUILLEE VALIDANT L'ACTE VOLONTAIRE D'UTILISATION.

EMC Compliance (CE)



This product is in accordance with the EMC directive 2014/30/EU through conformance with the following standards:

- EN 61000-6-4 (2007)
 Emission standard for industrial environment
 EN 55016-2-3, Class A (2010)
 EN 55022, Class A (2011)
- EN 61000-6-2 (2005) Immunity for industrial environment EN 61000-4-2 (2009) EN 61000-4-3 (2006) EN 61000-4-4 (2012) EN 61000-4-5 (2014) EN 61000-4-6 (2014)

HMS Industrial Networks AB Box 4126 300 04 Halmstad, Sweden info@hms.se



Further information and documents about this product can be found at the product pages on www.anybus.com.